

Ultrasonic compact heat and heat/cooling energy meters

WSx5.., WSx6..



Ultrasonic heat meters to measure flow and energy in hydronic heating or cooling circuits.

- Non-wearing due to non-moving parts
- Approved in accordance with EN 1434 and MID accuracy class 2
- Compact meter with flow measuring section
 - WSx5.. made of high-tech plastic
 - WSx6.. made of brass
- Mounting position optional (horizontal or vertical), heat or cooling side
- Measuring range of flow 1:100 conforming to EN 1434 (total range 1:1000)
- Optical interface as per EN 62056-21
- M-bus wired or M-bus RF communication
- Available as pure heat energy meters, cooling energy meters (optional) as well as combined heat/cooling energy meters
- Self diagnostics

Use

The heat (WSM5../WSM6..) and cooling energy meters (WSB5../WSB6..) and combined heat/cooling energy meters (WSN5../WSN6..) are measuring devices to physically acquire energy consumption. The device consists of a flow measuring section made of high-tech plastic (WSx5..) or brass (WSx6..), 2 ready connected temperature sensors, and an electronic unit which calculates the energy consumption from the flow and temperature differential. The compact meter WS.. is of compact design and therefore ideally suited for use in apartments. It is available in different versions for metering heat (WSM..) or cooling (WSB..) energy or combined heat/cooling energy (WSN..).

Restrictions:

The temperature sensors and battery of the WS.. compact meters cannot be replaced.

Functions

Meter design

The meter consists of electronic unit, flow measuring section and 2 temperature sensors. The electronic unit is equipped with long-life batteries, ensuring up to 11 years of operation.

Ultrasonic measuring principle

The flow is acquired based on the non-wear ultrasonic measuring principle, which requires no moving parts.

The amount of energy transferred from the medium to the consumer over a defined period of time is proportional to the temperature differential between the warmer and colder side and the volume of water that has passed through.

The water volume is measured in the measuring tube by ultrasonic pulses which are transmitted in the direction of flow and against the direction of flow. Downstream, the time difference between the transmitter and receiver is reduced, upstream it is increased. The water volume is calculated based on the difference in runtime.

The flow and return temperature is acquired by platinum resistors.

The water volume as well as the temperature difference between the warmer and cooler side is multiplied using a heat coefficient and the product is integrated. The result, which is the consumed amount of thermal energy, is stored and displayed in the physical unit kWh, the volume in m³.

The WS.. uses an intelligent, adaptive temperature-measuring interval. With changing system conditions (e.g. rapid increase of flow), the WS.. changes for a certain time to a fast temperature-measuring interval. Thus, the meter always adapts itself to the current situation and acquires the system temperatures very accurately.



NOTICE

In addition to heat energy, the meters measure cooling energy as an option that is added to a separate tariff register (uncalibrated). Heat energy is always measured if the temperature difference ($> +0.2\text{ K}$) and the flow is positive. Cooling energy is measured, if the temperature difference ($< -0.2\text{ K}$) is negative, while the flow is positive.

Processor unit

A common electronic unit applies to all flow variables.

Optical communication interface

The meter is equipped with an optical communication interface which facilitates readout and configuration on site with the help of the optical read head WZR-OP-USP and matching UltraAssist software.

M-bus communication (optional)

The meter can be read out from a remote location via an M-bus master unit, if the meter uses M-bus communication.

M-bus RF communication (optional)

If the meter uses M-bus RF communication, it can be read out remotely.

Tampering

To open the device, the calibration seal at the top of the WS.. must be destroyed.


Self diagnostics

The meter continuously performs self-diagnostics, allowing it to detect a number of mounting or device errors and to display them.

Technical design

The diagram below shows the typical accuracy of the WSx5.. / WSx6.. compared to the error limits per EN 1434 class 2.

Metering accuracy as per EN 1434

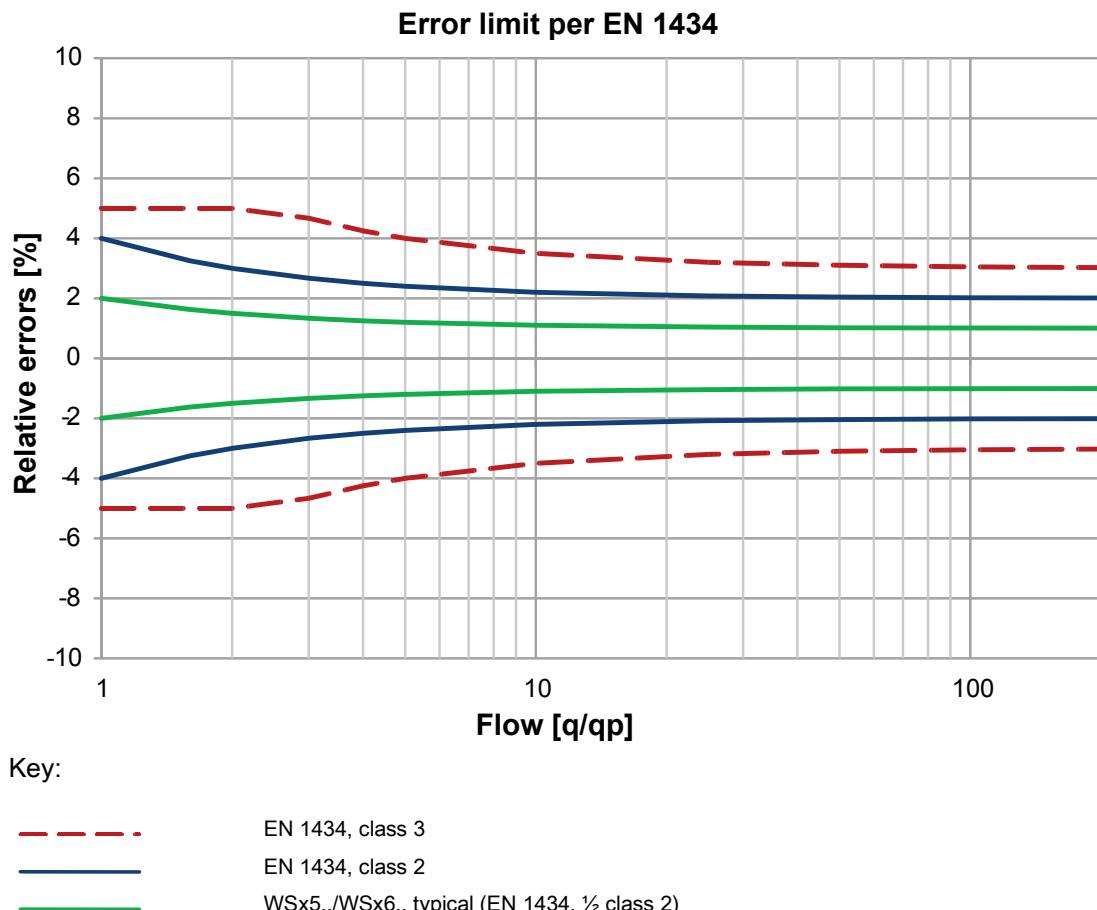

The pressure loss in a flow sensor is indicated as nominal flow q_p .

Actual pressure loss at the indicated flow can be calculated using the K_v value, which indicates flow at 1 bar differential pressure:

Δp = Pressure loss in bar

$$\Delta p = 1 \text{ bar} \times (Q / K_v)^2$$


Q = Flow in m^3 / h

$K_v = K_v - \text{Value at } \Delta p = 1 \text{ bar}$

Pressure loss characteristic WSx5..


Nominal flow q_p m^3/h	Mounting length mm	Connecting thread	Pressure loss at q_p mbar	K_v value at $\Delta p = 1 \text{ bar}$ m^3/h	Curve in the diagram
0.6	110	G $\frac{3}{4}$	75	2.2	A
1.5	110, 130	G $\frac{3}{4}$, G 1	135	4.1	B
2.5	130	G 1	135	6.8	C

The value can also be read graphically using the diagram as an alternative.

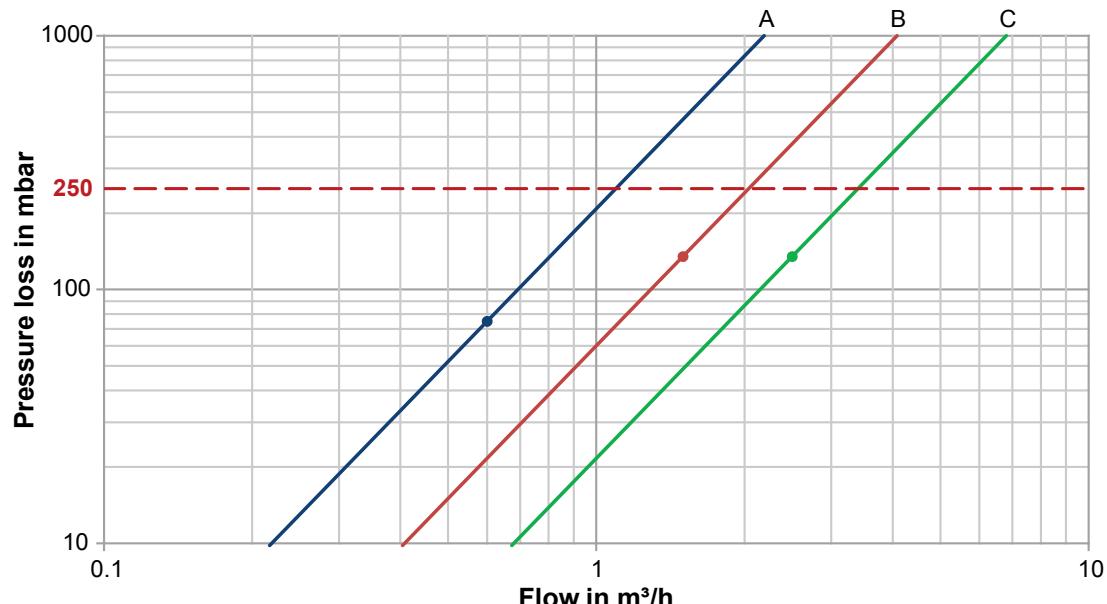


Pressure loss characteristic WSx6..

Nominal flow q_p m^3/h	Mounting length mm	Connection G/DN	Pressure loss at q_p mbar	K_v value at $\Delta p = 1 \text{ bar}$ m^3/h	Curve in the diagram
0,6	110, 190	G $\frac{3}{4}$	150	1.5	A
1.5	130, 190	G 1	160	3.8	B
1,5	110	G $\frac{3}{4}$,	150	3.9	C
2.5	190	G 1	210	5.3	D
2.5	130	G 1	200	5.6	E

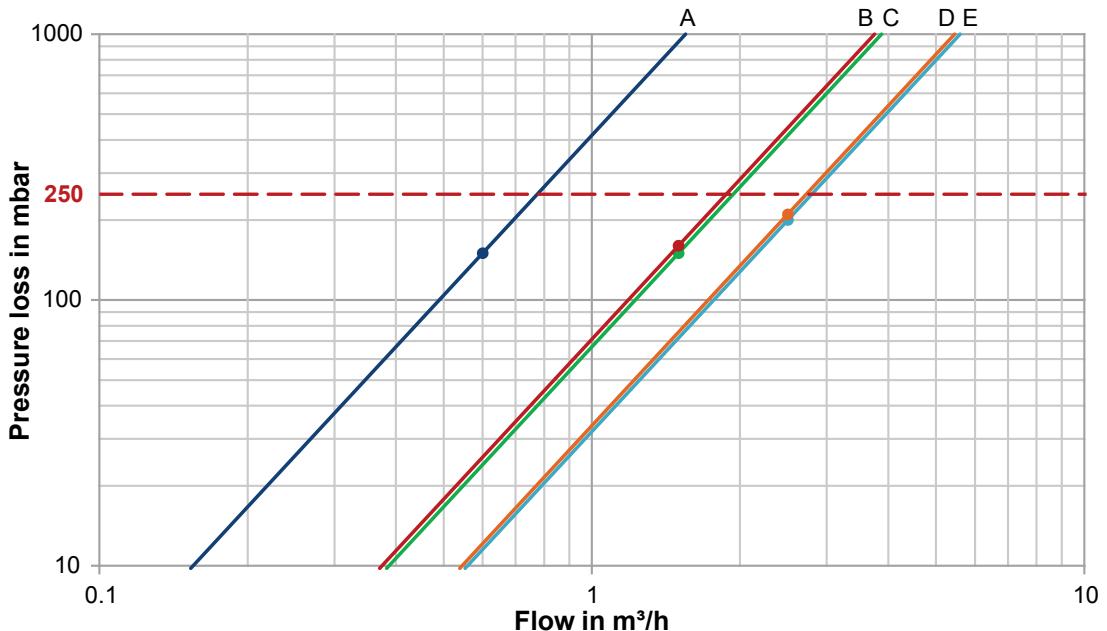

Display

The WS.. has a large, easy-to-read LCD with 7 digits to display different values (e.g. energy or flow). This new type of dynamic display enables users to identify positive flow at a glance. Icons for previous year values and previous month values support the easy-to-understand display concept.

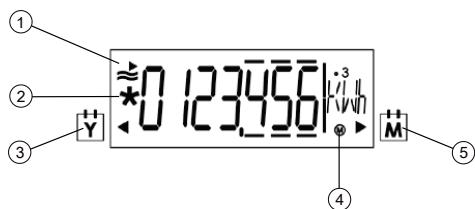

- | | | | |
|---|--|---|---|
| 1 | Activity indicator at flow | 4 | Icon for maximum |
| 2 | Star icon: Calibrated value | 5 | Icon for previous month value
Calibrated value |
| 3 | Icon for previous year value
Calibrated value | | |

The meter's display is subdivided into several loops.

A short press on the button (<2 s) lets the current loop pass through line by line. The first line displays again after the last line. A long press (>3 s) displays the first line of the next loop. The first loop is displayed again after the last loop.

The arrow icons mark the display of a stored value of the previous year or previous month. A calibrated value (e.g. energy) is marked on the display by a star symbol. The decimal places of displayed values are indicated by a frame.



1 Calibration seal
2 Display

3 Optical interface
4 Optical interface



NOTICE

The range of display and the displayed data may deviate from this description and certain button functions may be disabled, depending on the parameter settings on the meter. Moreover, certain push button functions can be locked.

User loop LOOP 0

1234567	kWh	Energy amount heat
1234567 cold	kWh	Energy amount cooling (optional)
1234567	m ³	Volume
0000000		Segment test
F-----		In case of error message with error code

Current values LOOP 1

1234567	m ³ /h	Current flow rate
1234567	kW	Current thermal energy
80.0	°C	Current temperature heat side at 2 second exchange with cooling side
50.0	°C	Change with the current temperature with cooling side

21.0	K	Temperature difference
Bd 1234	h	Runtine totalizer
Fd 123	h	Missing time
Pd 1234	h	Time with flow rate

Monthly values LOOP 2		
01.06.2011		Monthly date (due date) saving day
1234567	kWh	Monthly value (due date) energy amount heat
1234567 cold	kWh	Monthly value (due date) energy amount cooling (optional)
1234567	m³	Monthly value (due date) volume on set day
Fd 123	h	Missing time on set day
3.123	m³/h	Maximum flow rate on set day, at 2-second intervals with date stamp
03.02.10		
279.4	kW	Maximum output at 2-second intervals
03.02.10		
93.7	°C	Maximum output heat side at 2-second intervals with date stamp
03.02.10		
64.8	°C	Maximum output cooling side at 2-second intervals with date stamp
03.02.10		

General / communication LOOP 3		
1234567		Device number, 7 digits
OMS		RF standard (M-bus RF only)
Unbind		Meter not connected (M-bus RF only)
Bind		Meter connected (M-bus RF only)
MbuS		Interface (only for M-bus)
127A		Primary address (only for M-bus)
0000000A		Secondary address (only for M-bus)
01.01		Due date (yearly set day)
01.--.--		Monthly value (monthly set day)
I 5-00	FW	Firmware version
CrC 1234		CRC code, part requiring calibration

Other LOOP 4		
17.11.11		Current date [TT.MM.JJ]
10.38.57		Current time of day [hh.mm.ss]
-----	C	Code entry for test/parameter operation

Error messages

The meter continuously performs self-diagnostics, allowing it to detect and display a number of mounting or device errors.

FL	nEG	Wrong direction of flow
DIFF	nEG	Negative temperature differential
F0		Flow cannot be measured
F1		Break in sensor heat side
F2		Break in sensor cold side
F3		Electronics for temperature assessment defective
F4		Battery empty, power supply problem
F5		Short circuit sensor, heat side
F6		Short circuit sensor, cold side
F7		Disruption of internal memory operation
F8		F1, F2, F3, F5 or F6 persist longer than 8 hours Detection of tampering No further measurements are made
F9		Error in the electronics



NOTICE

Manually reset message F8 in configuration mode or using the service software. All other error messages are deleted automatically as soon as the error is eliminated.

Previous year's values

The electronic unit stores the meter readings for energy, volume, missing time, and flow measuring time as well as the current maximum values of flow rate, power, temperature heat and cold side with their date stamps on a yearly set day.

The set day for previous year values can be parameterized.

Monthly values

The electronic unit stores the meter readings for energy, volume, missing time, and flow measuring time as well as the monthly maximum values of flow rate, power, temperature heat and cold side with their date stamp for up to 24 months on the set day of each month.

The set day for previous monthly values can be parameterized.

In addition, a second programmable monthly set day is available for 24 months – the day on which energy and volume are stored.

Standard parameters

The UH50.. comes programmed as follows:

- Set day [TT.MM]: 01.01

Data telegram for mobile data acquisition on WSM5xx-FE

The following data is factory set to acquire data (send interval 30 seconds at a batter life of 11 years):

- Current energy
- Energy set day for each month
- Energy on a yearly set date
- Set day (year)
- Error
- Current time stamp

Type summary



Cooling energy meter WSB.. is available upon request.

Heat meters WSM and combined heat/cold meters WSN..

The types of meters listed below are equipped as follows:

Mounting location	In return
Rated pressure	PN 16
Length of control cable	1.5 m
Sensor mounting	Return sensor, integrated in the flow measuring section
Sensor type	Pt500, Ø 5.2 mm, length = 45 mm
Temperature sensor cable length	1.5 m
Approval	EN 1434 class 2 MID 2004/22/EG
Display	kWh

Heat meter with high-tech plastic flow measuring section WSM5..

Heat meter nominal flow 0.6 m³/h

Options	Order number	Type
Mounting length 110 mm, connecting thread G ³ / ₄ ", battery life 6 years without communication	LYU:WSM506-0A	WSM506-0A
Mounting length 110 mm, connecting thread G ³ / ₄ ", battery life 11 years without communication	S55561-F133	WSM506-0E
Mounting length 110 mm, connecting thread G ³ / ₄ ", battery life 11 years, M-bus	S55561-F194	WSM506-BE
Mounting length 110 mm, connecting thread G ³ / ₄ ", battery life 11 years, M-bus RF	S55561-F246	WSM506-FE

Heat meter nominal flow 1.5 m³/h

Options	Order number	Type
Mounting length 110 mm, connecting thread G ^{3/4} ", battery life 6 years without communication	LYU:WSM515-0A	WSM515-0A
Mounting length 110 mm, connecting thread G ^{3/4} ", battery life 11 years without communication	S55561-F135	WSM515-0E
Mounting length 110 mm, connecting thread G ^{3/4} ", battery life 11 years, M-bus	S55561-F195	WSM515-BE
Mounting length 110 mm, connecting thread G ^{3/4} ", battery life 11 years, M-bus RF	S55561-F247	WSM515-FE

Heat meter nominal flow 2.5 m³/h

Options	Order number	Type
Mounting length 130 mm, connecting thread G1", battery life 6 years without communication	LYU:WSM525-0A	WSM525-0A
Mounting length 130 mm, connecting thread G1", battery life 11 years without communication	S55561-F137	WSM525-0E
Mounting length 130 mm, connecting thread G1", battery life 11 years, M-bus	S55561-F196	WSM525-BE
Mounting length 130 mm, connecting thread G1", battery life 11 years, M-bus RF	S55561-F248	WSM525-FE

Heat meter with brass flow measuring section WSM6..

Options	Order number	Type
Nominal flow 0.6 m ³ /h Mounting length 110 mm, connecting thread G ^{3/4} ", battery life 11 years, M-bus	S55561-F249	WSM606-BE
Nominal flow 1.5 m ³ /h Mounting length 110 mm, connecting thread G ^{3/4} ", battery life 11 years, M-bus	S55561-F250	WSM615-BE
Nominal flow 2.5 m ³ /h Mounting length 130 mm, connecting thread G1", battery life 11 years, M-bus	S55561-F251	WSM625-BE

Combined heat/cooling energy meters with brass flow measuring section WSN6..

Options	Order number	Type
Nominal flow 0.6 m ³ /h Mounting length 110 mm, connecting thread G ^{3/4} ", battery life 11 years, M-bus	S55561-F266	WSN606-BE
Nominal flow 1.5 m ³ /h Mounting length 110 mm, connecting thread G ^{3/4} ", battery life 11 years, M-bus	S55561-F267	WSN615-BE
Nominal flow 2.5 m ³ /h Mounting length 130 mm, connecting thread G1", battery life 11 years, M-bus	S55561-F268	WSN625-BE

Accessories

Mounting accessories only for meters with high-tech plastic flow measuring sections:

Accessories for WSx5..

Component	Order number	Type
Mounting kit G $\frac{3}{4}$ ", consisting of: 2x threaded connection G $\frac{3}{4}$ " x R $\frac{1}{2}$ " 2x cap nuts G $\frac{3}{4}$ " 2x gaskets G $\frac{3}{4}$ "	LYU:T23-E34	T23-E34
Mounting kit G1", consisting of: 2x threaded connection G1" x R $\frac{3}{4}$ " 2x cap nuts G1" 2x gaskets G1"	LYU:T23-E1	T23-E1
10x gaskets EPDM G $\frac{3}{4}$ "	LYU:T23-34EPDM10	T23-34EPDM10
10x gaskets EPDM G1"	LYU:T23-1EPDM10	T23-1EPDM10

Mounting accessories only for meters with brass flow measuring sections:

Accessories for WSx6..

Component	Order number	Type
Mounting kit G $\frac{3}{4}$ ", consisting of: 2x threaded connection G $\frac{3}{4}$ " x R $\frac{1}{2}$ " 2x cap nuts G $\frac{3}{4}$ " 2x gaskets G $\frac{3}{4}$ "	S55563-F124	WZM-E34
Mounting kit 1", consisting of: 2x threaded connection G1" x R $\frac{3}{4}$ " 2x cap nuts G1" 2x gaskets G1"	S55563-F123	WZM-E1
Adapter piece 110 mm G $\frac{3}{4}$ " to 130 mm G $\frac{3}{4}$ ": 1x extension G $\frac{3}{4}$ B" to G $\frac{3}{4}$ B" 1x gasket G $\frac{3}{4}$ "	LYU:WZM-V130	WZM-V130
Adapter piece 110 mm G $\frac{3}{4}$ " to 130 mm G1": 2x extension G $\frac{3}{4}$ B" to G1 B" 2x gaskets G $\frac{3}{4}$ " 2x gaskets G1"	LYU:WZM-V130.G1	WZM-V130.G1
Adapter piece 110 mm G $\frac{3}{4}$ " to 165 mm G $\frac{3}{4}$ ": 1x extension G $\frac{3}{4}$ B" to G $\frac{3}{4}$ B" 1x gasket G $\frac{3}{4}$ "	LYU:WZM-VE165	WZM-VE165
Adapter piece 110 mm G $\frac{3}{4}$ " to 190 mm G1": 2x extension G $\frac{3}{4}$ B" to G1 B" 2x gaskets G $\frac{3}{4}$ " 2x gaskets G1"	LYU:WZM-V190	WZM-V190
Sealing disk for thread G $\frac{3}{4}$ ", threaded connection R $\frac{1}{2}$ "	LYU:9060944002	9060944002
Sealing disk for thread G1", threaded connection R $\frac{3}{4}$ "	LYU:9060944003	9060944003

Mounting set for sensor Ø 5.2x45 mm, consisting of: - 1 sensor mount brass DS M10x1 mm - 1 O-ring - 1 dowel pin	LYU:9930127002	9930127002
Sealing disk for temperature sensor M10x1 mm, Ø 8.6/5.3x1 mm, hard fiber	LYU:9060944001	9060944001
Sealing disk for temperature sensor M10x1 mm, Ø 8.6/5.3x1.5 mm, copper	LYU:9060950	9060950
Sealing disk, copper, for protection pocket G1½" or adapter WZT-A12, Ø 27.9/ 21.2 mm x 1.5 mm	LYU:9060948	9060948

Mounting accessories for both compact meter types:

Accessories for WSx5../WSx6..

Component	Order number	Type
Ball valve R½" with union nut G¾"	LYU:WZT-K12-34	WZT-K12-34
Ball valve R¾ " with union nut G¾"	LYU:WZT-K34-34	WZT-K34-34
Ball valve R¾ " with union nut G1"	LYU:WZT-K34-1	WZT-K34-1
Ball valve R1" with union nut G1"	LYU:WZT-K1-1	WZT-K1-1
Ball valve R½" to install a DS sensor M10 x 1 mm, length = 28 mm, max. 130°C, PN 25	S55563-F104	WZT-K12
Ball valve R¾" to install a DS sensor M10 x 1 mm, length = 28 mm, max. 130°C, PN 25	S55563-F120	WZT-K34
Ball valve R1" to install a DS sensor M10 x 1 mm, length = 28 mm, max. 130°C, PN 25	S55563-F119	WZT-K1
Adapter G3/8 B" with threaded hole M10x1 mm for sensor, including gasket G3/8" made of copper	LYU:WZT-A38	WZT-A38
Adapter G½ B" with threaded hole M10x1 mm for sensor, including gasket G½" made of copper	S55563-F116	WZT-A12
Adapter G¾ B" with threaded hole M10x1 mm for sensor, including gasket G¾" made of copper	LYU:WZT-A34	WZT-A34
Protection pocket G½ B" made of brass, Ø 5.2x35 mm for temperature sensor Ø 5.2x45 mm, including gasket G½", copper	S55563-F103	WZT-M35
Protection pocket G½ B made of brass, Ø 5.2x50 mm for temperature sensor Ø 5.2x45 mm, including gasket G½", copper	LYU:WZT-M50	WZT-M50
Adapter kit consisting of: - 1 plastic sensor adapter Ø 5.2x45 mm - 1 mounting aid for sensor Ø 5.2x45 mm - 2 O-rings	LYU:9956230	9956230
Spacer G¾", length 110 mm, including 2 gaskets	LYU:WZM-G110	WZM-G110
Spacer G1", length 130 mm, including 2 gaskets	LYU:WZM-G130	WZM-G130

Welding sleeve with threaded hole for temperature sensor DS M10x1 mm	S55563-F121	WZT-G10
Self-lock seal with sealing wire	LYU:9956186001	9956186001
10 wall adapters for mounting the electronic unit on the wall, including 2 screws and 2 dowels	LYU:T23-WA10	T23-WA10

Programming accessories

Component	Order number	Type
Optical read head with USB plug for PC interface	LYU:WZR-OP-USB	WZR-OP-USB
Readout and configuration software: - UltraAssist	Download	-

Ordering

Please specify the quantity, order number, and type when ordering.

Scope of delivery

The ultrasonic meter is supplied complete with Mounting Instructions in different languages, an adapter kit, 2 gaskets and a seal.

Languages

The Installation Instructions are supplied in the following languages:

Bulgarian, Chinese, Czech, Dutch, English, French, German, Greek, Hungarian, Italian, Norwegian, Polish, Russian, Serbo-Croatian, Slovakian, Slovenian, Spanish and Turkish.

Product documentation

Related documents such as environmental declarations, CE declarations, etc., can be downloaded at the following Internet address:

<http://siemens.com/bt/download>

Notes

Mounting

Flow measuring section

The mounting orientation is optional, the mounting location (heat or cold side) must correspond to the meter type.

On heat energy meters or combined heat/cooling energy meters, the mounting location of the cooling side corresponds to the return  and the mounting location of the heating side to the flow .

On cooling energy meters, the mounting location of the heating side corresponds to the return  and the mounting location of the cooling side to the flow .

Settling paths are not required, neither upstream of nor downstream from the meter. If the meter is installed in the common return of 2 heating circuits, e.g. space heating and DHW, the mounting location must be at an adequate distance from the T-piece (min. 10 x DN) to allow the different water temperatures to properly mix.


Thoroughly flush the plant prior to installing the meter.

Mount the flow measuring section between 2 shutoff valves with the arrow pointing in the direction of flow. The sensors must be mounted in the same water circuit as the flow measuring section (observe mixing). Do not separate, shorten, or extend the lines. The sensors can be fitted in T-pieces or ball valves, or can be immersed, either directly or in pockets (observe all national regulations). In any case, the end of the sensors' probe must extend to at least the pipe center. Temperature sensors and fittings must be sealed to prevent tampering.



NOTICE

- Comply with all local mounting regulations for meters when mounting the meter.
- Protect the meter against damage from shocks and vibrations at the mounting location.
- Ensure that no water can enter the processor unit at the mounting location.

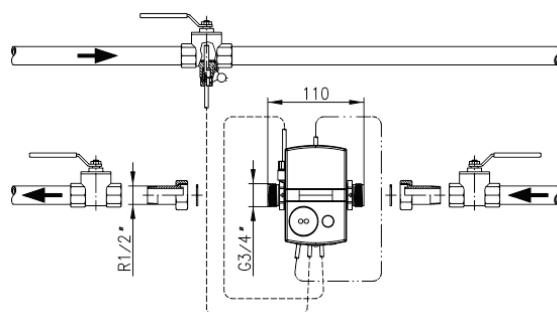


Mounting with ball valve

Required position for the cooling energy meter

To avoid the formation of condensation on cooling energy or combined heat/cooling energy meters, make sure the cover on the measuring tube points to the side or downward. Install the protection pockets so that the temperature sensor is horizontal or vertical, pointing down. Mount the processor unit away from the flow measuring section (e.g. on the wall). Make sure that condensation cannot run along the connected lines, entering the processor unit (forming a loop downward).

Permissible mounting position when metering cooling energy:

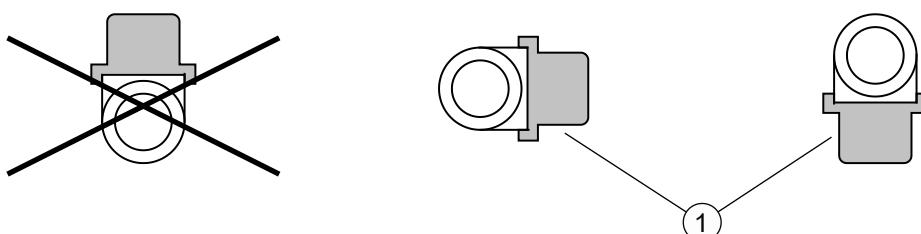

1 Transducer cover (only applies to WSx6..)

Processor unit

The ambient temperature of the processor unit cannot exceed 55 °C. Avoid direct sunlight.

Ensure that no water can enter the processor unit at the mounting location.

For water temperatures between 10 °C and 90 °C, the processor can be secured to the flow measuring section.

For water temperatures above 90 °C and/or below 10 °C, mount the processor unit on the wall (split mounting).

The adapter plate on the wall or the flow measuring section can be aligned as needed to ensure ease of reading. To remove the electronic unit, turn the housing by 45° to the side and lift.


To fit the processor unit to the wall, remove it from the flow measuring section and screw the adapter plate to the wall and slide the processor unit to the adapter base, snapping into place.




NOTICE

WSx5..: The adapter plate cannot be removed. The wall adapter must be ordered separately as an accessory.


WSx6..: The adapter plate can be removed from the flow measuring section.

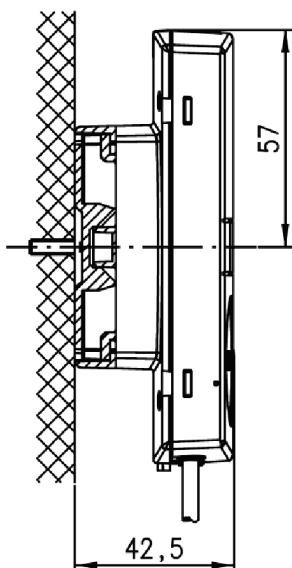


Wall mounting

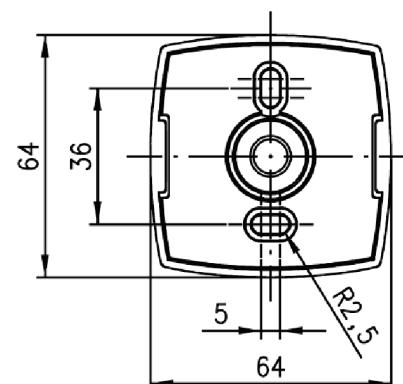

Wall adapter (view from above)

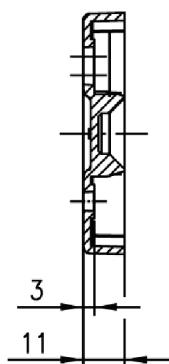

Wall adapter (side view)

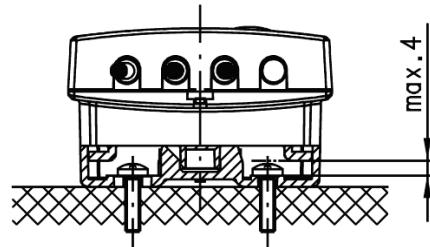

Maximum screw head height
(if using the wall bracket)

Maintenance

The meters are maintenance-free.
Observe all national calibration regulations.

Disposal



The device is considered an electronic device for disposal in accordance with the European Guidelines and may not be disposed of as domestic garbage.

- Dispose of the device through channels provided for this purpose.
- Comply with all local and currently applicable laws and regulations.
- Dispose of empty batteries in designated collection points.

Warranty service

The application-related technical data is only guaranteed together with the products mentioned in this data sheet. Siemens rejects any and all warranties in the event that third-party products are used.

Processor unit

Power	
Battery type	Lithium battery (cannot be replaced)
Battery voltage	3.6 V
Battery life	6 or 11 years

Function data	
Measuring range	0...180 °C
Range of temperature differential $\Delta\Theta$	3 ... 80 K
Temperature response threshold	0.2 K
Thermal coefficient	Shifting compensated
Temperature-measuring error without sensor	(0.5 + $\Delta\Theta_{min.}/\Delta\Theta$) %, max. 1.5 % at $\Delta\Theta = 3$ K

Temperature sensor.	
Sensing element	Pt500
Type	Ø 5.2 x 45 mm

Flow measuring section

Function data	
Temperature range (national approvals may differ)	
• Heat	5...90 °C (plastic flow measuring sections) 5...105 °C (brass flow measuring section)
• Cooling	5...50 °C (Observe national approvals)
Maximum temperature t_{max}	°C
Rated pressure	MPa
Nominal flow q_p	m^3/h
Metrological class	
Maximum flow q_s	m^3/h
Minimum flow q_i	l/h
Response threshold	l/h
Pressure drop at q_p	
• Mounting length 110 mm Δp	mbar
• Mounting length 130 mm Δp	mbar
Flow rate at $\Delta p = 1$ bar, K_v , m^3/h	
Mounting position	
¹⁾ Plastic flow measuring section	
²⁾ Brass flow measuring section	

Communication	
Optical interface	Similar to EN 62056-21 Per EN 13757-2 / -3
• Basic design	
• Protocol	
M-bus wired interface	Option
• Voltage $V_{max.}$	50 V
• Power consumption	1 M-bus load
• Address	Primary or secondary
• Baud rate	300 or 2400 baud
• Max. permissible reading frequency	1x per minute
• Protocol	As per EN 13757-2/-3, EN 1434-3
• Connection cable length and cross section	1.5 m, 2x AWG24/0.2 mm ²
M-bus RF interface	Option
• Transmission frequency	868.95 MHz (868.90 ... 869.00 MHz)
• Transmitter power	Min. 3.16 mW (5 dBm) to max. 25 mW (13.9 dBm)
• Power supply	Max. 3 AA batteries
• Send heartbeat	
– Mobile data acquisition	20...34 s
– Stationary data acquisition	15 minutes
– User defined telegrams	12...900 s (depending on telegram length)
Protocol	Per EN 13757-4
Cable length, control cable	1.5 m

Housing type	
Protection class	III
IP class	
• Processor unit	IP54
• Flow measuring section	WSx5..: IP65 WSM6..: IP54 WSB6../WSN6..: IP65

Ambient conditions			
	Operation EN 60721-3-3	Transportatio n EN 60721-3-2	Storage EN 60721-3-1
Climatic conditions	Class A	Class A	Class A
Temperature	5...55 °C	-20...60 °C	-20...60 °C
Humidity	<93% r.h. at 25 °C (non-condensing)	<93% r.h. at 25 °C (non-condensing)	<93% r.h. at 25 °C (non-condensing)
Mechanical conditions	Class M1	Class M1	Class M1
Max. altitude	Min. 700 hPa, corresponding to max. 2000 m above sea level		

Standards, guidelines	
Product standards	DIN EN 1434-x (heat meters)
EU conformity (CE)	CE2T5372xx *)
RCM Conformity	CE2T5372en_C1 *)

Environmental compatibility	
The product environmental declaration CE2E5372en *) contains data on environmentally compatible product design and assessments (RoHS compliance, material composition, packaging, environmental benefit, and disposal).	

Dimensions (W x H x D)	
Processor unit	116 x 71 x 32 mm
Flow measuring section	See "Dimensions"

Housing material	
Cover	ABS
Bottom section	PC-GF10
Battery compartment	PC clear


Housing colors	
Cover	RAL 9006
Bottom section	RAL 9002

Weight	
Device packed complete with inserts	WSM506..: 0.52 kg WSM515..: 0.52 kg WSM525..: 0.56 kg WSx606..: 0.80 kg WSx615..: 0.76 kg WSx625..: 0.84 kg

*) Documents can be downloaded at <http://www.siemens.com/bt/download>.

Connection diagram



For meters with M-bus communication

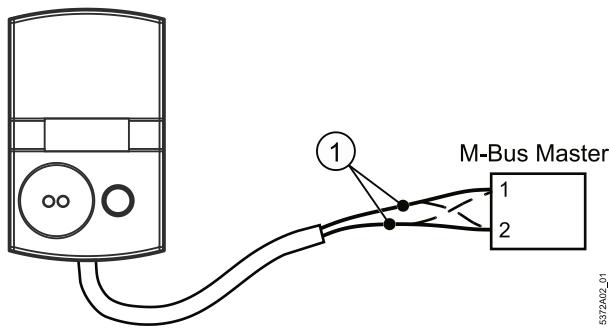


1 Brown / white

Dimensions

WSx5..

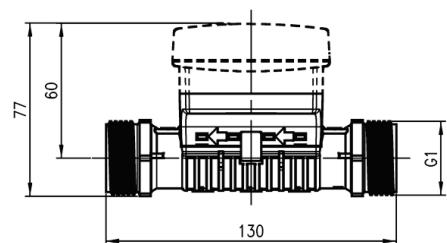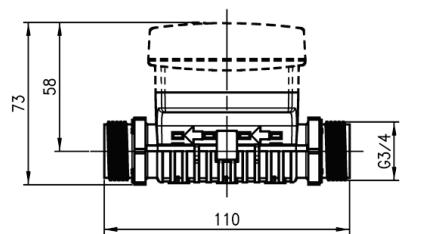

WSx6..

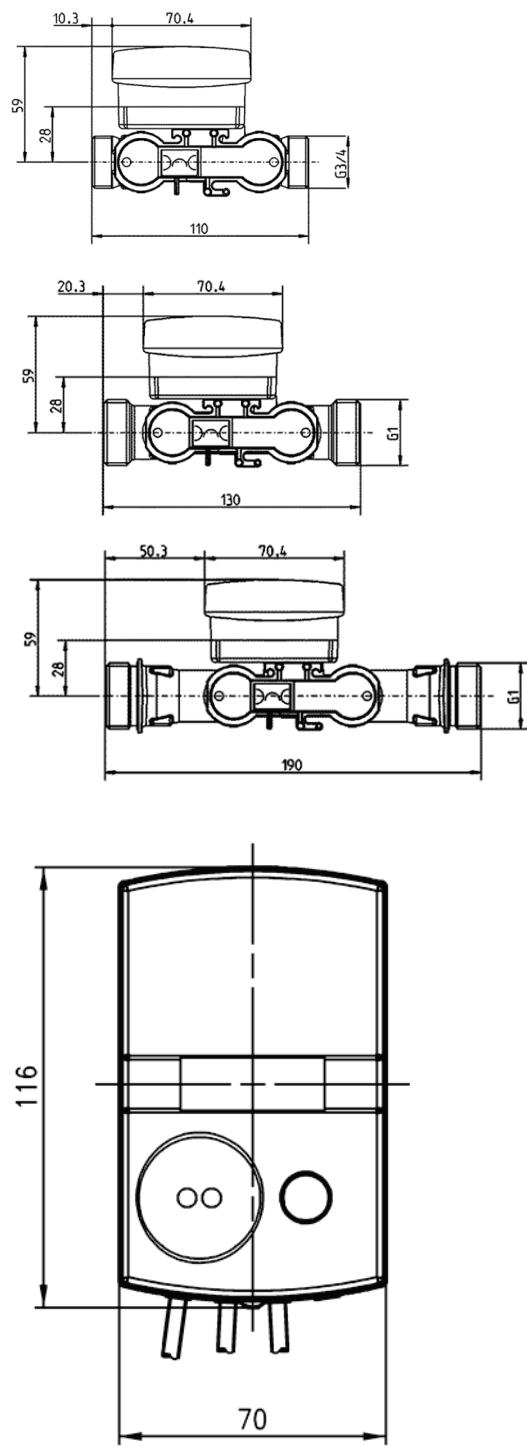

Dimensions in mm

Issued by
Siemens Switzerland Ltd
Building Technologies Division
International Headquarters
Theilerstrasse 1a
CH-6300 Zug
Tel. +41 58 724 2424
www.siemens.com/buildingtechnologies

© Siemens Switzerland Ltd, 2012
Technical specifications and availability subject to change without notice.